

IEC**IECEE**

Ref. Certif. No.

CN55584-M1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME**CB TEST CERTIFICATE**

Product

Moulded Case Circuit Breaker

Name and address of the applicant

Zhejiang CHINT Electrics Co., Ltd.
No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town,
Yueqing City, Zhejiang Province, P.R.China

Name and address of the manufacturer

Zhejiang CHINT Electrics Co., Ltd.
No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town,
Yueqing City, Zhejiang Province, P.R.China

Name and address of the factory

NOARK Electrics (Shanghai) Co., Ltd.
No.3857 Sixian Road, Songjiang District, Shanghai, P.R.China*Note: When more than one factory, please report on page 2*

Ratings and principal characteristics

See the Appendix

Trademark / Brand (if any)

CHINT

Customer's Testing Facility (CTF) Stage used

N/A

Model / Type Ref.

NB8-125;

Additional information (if necessary may also be reported on page 2)

The latest CB certificate No. is CN55584, dated 2021-12-14. The M1 modification is to add DC parameters.

A sample of the product was tested and found to be in conformity with

IEC 60947-2:2016/AMD1:2019;IEC 60947-2:2016(5th Edition)

As shown in the Test Report Ref. No. which forms part of this Certificate

03601-A-22CB0145-S-M1

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86-10-83886666 Fax: +86-10-83886282

website: <http://www.cqc.com.cn>

Date: May.16,2023

Signature:

Xie ZhaoXu

CB 0072481

NB8-125

Ui:630V;Uimp:6kV;

Ue:AC230V/240V(1P),AC400V/415V(2P/3P/4P),

DC110V(1P appearance),DC220V(2P appearance);

In:80A,100A,125A;


Ics:75%Icu;Icu:10kA;

Overcurrent release type: thermo-magnetic;

Selective category: A;

Suitable for isolation; 50/60Hz.

Connection method:

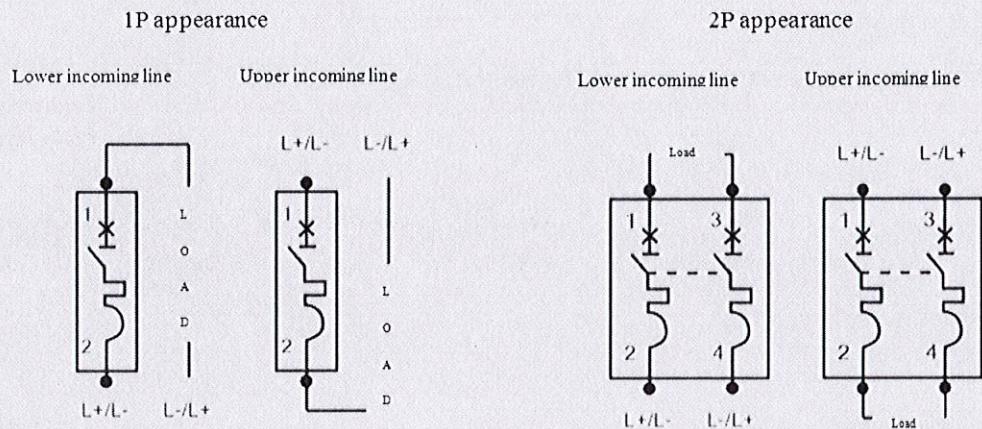

Page 1 of 1

Additional information (if necessary)

Date: May.16,2023

Signature:

Xie ZhaoXu