



3. Type designation

N B 1 - 63 DC
 Direct Current
 Frame size rated current
 Designed sequence number
 MCB
 Company code

4. Operating conditions

- 4.1 Ambient temperature: -35°C ~ +70°C (Refer to 5.3)
- 4.2 The atmosphere condition: ≤ 95%
- 4.3 Pollution degree: II
- 4.4 Altitude: ≤ 2000m (if exceed 2000m, Refer to 5.4)

NB1-63DC DC Circuit Breaker

1. General

- 1.1 Certificates: CCC, CE, CB, TUV;
- 1.2 Standard: IEC/EN 60947-2, RoHS;
- 1.3 Rated voltage up to 1000V, Rated current up to 63A;
- 1.4 Protection of circuits against overload currents;
- 1.5 Protection of circuits against short-circuit currents;
- 1.6 NB1-63 DC circuit-breakers are used in communication systems and PV DC systems.

2. Features

- 2.1 Excellent breaking capacity
- 2.2 Double connection function of lead wire and bus bar
- 2.3 Stored energy operation, fast closing, long service life
- 2.4 Convenient installation, disassembly
- 2.5 Contact on-off indication, higher security
- 2.6 Green environmental protection and energy saving

5. Technical data

- 5.1 Classification
 - 5.1.1 Rate Current In: 1A, 2A, 3A, 4A, 6A, 10A, 13A, 16A, 20A, 25A, 32A, 40A, 50A, 63A
 - 5.1.2 Number of poles: 1P, 2P, 4P
 - 5.1.3 Tripping curves: C Type, (7~10)In
- 5.2 Parameters
 - 5.2.1 Rated breaking capacity Icu

| Rated current In (A) | Number of poles | Rated voltage Ue (V) | Rated breaking capacity Icu (A) |
|----------------------|-----------------|----------------------|---------------------------------|
| 1~63 | 1 | 250 | 6000 |
| | 2 | 500 | 6000 |
| | 4 | 1000 | 6000 |

5.2.2 Electrical and mechanical life

- a. Electrical life: > 1500 cycles
 - b. Mechanical life: > 20,000 cycles
- 5.2.3 Rated impulse withstand voltage Uimp:4kV

5.2.4 (28-32)°C ambient temperature over-current protection features.

| Test | Test current | Initial state | Time limit for tripping or not tripping | Expected result | Remarks |
|------|--------------|---------------------------|---|-----------------|---------------------------------|
| a | 1.05In | Cold state | t≤1h | Not tripping | |
| b | 1.30In | Right after test number a | t≤1h | Tripping | The current is rising within 5s |
| c | 7In | Cold state | t≤0.2s | Not tripping | |
| d | 10In | Cold state | t < 0.2s | Tripping | |

Note: The terminology "Cold state" means that the test is performed at the base calibration temperature with no load prior to the test.


5.3 Temperature derating

| Rated current (A) | Temperature compensation coefficient under various operational temperature. | | | | | | | | | | | |
|-------------------|---|-------|-------|-------|-------|-------|-------|------|-------|-------|-------|-------|
| | -35°C | -30°C | -20°C | -10°C | 0°C | 10°C | 20°C | 30°C | 40°C | 50°C | 60°C | 70°C |
| 1 | 1.3 | 1.26 | 1.23 | 1.19 | 1.15 | 1.11 | 1.05 | 1 | 0.96 | 0.93 | 0.88 | 0.83 |
| 2 | 2.6 | 2.52 | 2.46 | 2.38 | 2.28 | 2.2 | 2.08 | 2 | 1.92 | 1.86 | 1.76 | 1.66 |
| 3 | 3.9 | 3.78 | 3.69 | 3.57 | 3.42 | 3.3 | 3.12 | 3 | 2.88 | 2.79 | 2.64 | 2.49 |
| 4 | 5.2 | 5.04 | 4.92 | 4.76 | 4.56 | 4.4 | 4.16 | 4 | 3.84 | 3.76 | 3.52 | 3.32 |
| 6 | 7.8 | 7.56 | 7.38 | 7.14 | 6.84 | 6.6 | 6.24 | 6 | 5.76 | 5.64 | 5.28 | 4.98 |
| 10 | 13.2 | 12.7 | 12.5 | 12 | 11.5 | 11.1 | 10.6 | 10 | 9.6 | 9.3 | 8.9 | 8.4 |
| 13 | 17.16 | 16.51 | 16.25 | 15.6 | 14.95 | 14.43 | 13.78 | 13 | 12.48 | 12.09 | 11.57 | 10.92 |
| 16 | 21.12 | 20.48 | 20 | 19.2 | 18.4 | 17.76 | 16.96 | 16 | 15.36 | 14.88 | 14.24 | 13.44 |
| 20 | 26.4 | 25.6 | 25 | 24 | 23 | 22.2 | 21.2 | 20 | 19.2 | 18.6 | 17.8 | 16.8 |
| 25 | 33 | 32 | 31.25 | 30 | 28.75 | 27.75 | 26.5 | 25 | 24 | 23.25 | 22.25 | 21 |
| 32 | 42.56 | 41.28 | 40 | 38.72 | 37.12 | 35.52 | 33.93 | 32 | 30.72 | 29.76 | 28.16 | 26.88 |
| 40 | 53.2 | 51.2 | 50 | 48 | 46.4 | 44.8 | 42.4 | 40 | 38.4 | 37.2 | 35.6 | 33.6 |
| 50 | 67 | 65.5 | 63 | 60.5 | 58 | 56 | 53 | 50 | 48 | 46.5 | 44 | 41.5 |
| 63 | 83.79 | 81.9 | 80.01 | 76.86 | 73.71 | 70.56 | 66.78 | 63 | 60.48 | 58.9 | 55.44 | 52.29 |


5.4 Altitude derating

| Tripping type | Rated current In (A) | Current correction factor | | | For example |
|---------------|---|---------------------------|------------|--------|--|
| | | ≤2000 | 2000~3000m | ≥3000m | |
| C | 1,2,3,4,6,10, 13,16,20,32, 40,50,63 | 1 | 0.9 | 0.8 | Rated current of 10A products rated current derating 2500m:0.9×10=9A |

5.5 Curves shown in Figure 1

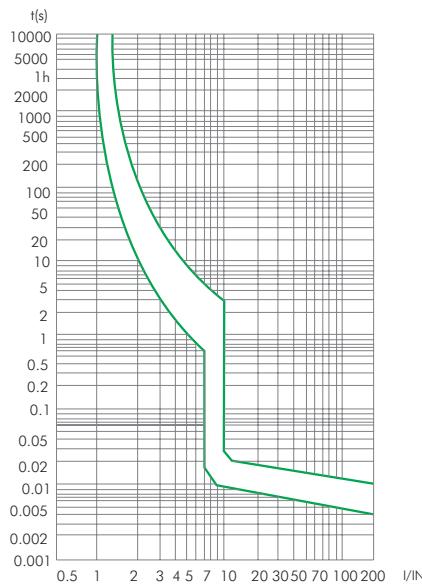

5.8 DC application wiring diagram shown in Figure 2

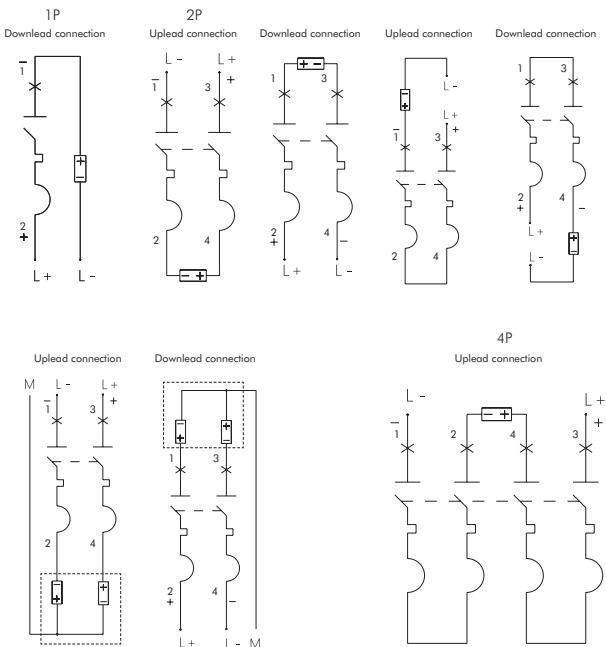

5.6 Wiring: Apply to 25 mm² wire connection terminals

Tightening torque 2N·m

| Rated current In (A) | Copper wire nominal cross sectional area(mm ²) |
|----------------------|--|
| 1~6 | 1 |
| 10 | 1.5 |
| 13,16,20 | 2.5 |
| 25 | 4 |
| 32 | 6 |
| 40,50 | 10 |
| 63 | 16 |

5.7 Each pole power consumption of the circuit breaker

| Rated current In (A) | Each pole maximum power consumption(W) |
|----------------------|--|
| 1~10 | 2 |
| 13~32 | 3.5 |
| 40~63 | 5 |

Wiring diagram description:

- 1.L+:Positive pole of power supply,L-:Negative pole of power supply;
- 2.+:Positive pole of circuit breaker,-:Negative pole of circuit breaker;
3. :Load;
- 4.The DC power supply is usually 'L-'grounded.The neutral pole 'M' of the positive and negative power supply system is grounded.

